

SOULDAL NV
Werner Dierckx
Everdongenlaan 18-20
BE-2300 Turnhout
Belgium

Handled by, department
Lars Cedheim
Chemistry and Materials Technology
+46 33 16 52 69, lars.cedheim@sp.se

Date
Sept. 17, 2004

Reference
F4 17365

Determination of NCO-content of prepolymer for construction foam via IR analysis (1 appendix)

Objects

One sample of prepolymer for PU-foam.

Sample marking:	T510
Packaging:	Tin can
Arrival Date:	Sept. 13, 2004
Testing Date:	Sept. 13, 2004

Assignment

Perform an infrared analysis of an NCO-free prepolymer for PU-foam

Method

The sample was pressed between two potassium bromide crystal windows and analysed with a Fourier transform infrared spectrophotometer between 4000 cm^{-1} to 600 cm^{-1} .

Result

The IR-spectrum is shown in appendix 1. There is no sign that NCO-groups are present. The presence of NCO-groups would be detected since both alkyl and aryl compounds with NCO-group absorb in the range 2274 cm^{-1} to 2242 cm^{-1} .

SP Swedish National Testing and Research Institute
Chemistry and Materials Technology - Organic Analytical Chemistry



Benny Lyvén
Technical Manager



Lars Cedheim
Technical Officer

Appendix
Graph


SP Swedish National Testing and Research Institute

Postal address
SP
Box 857
SE-501 15 Borås
SWEDEN

Phone / Fax / E-mail
+46 33 16 50 00
+46 33 13 55 02
info@sp.se

Reg. number
556464-6874

This document may not be reproduced other than in full, except with the prior written approval of SP.

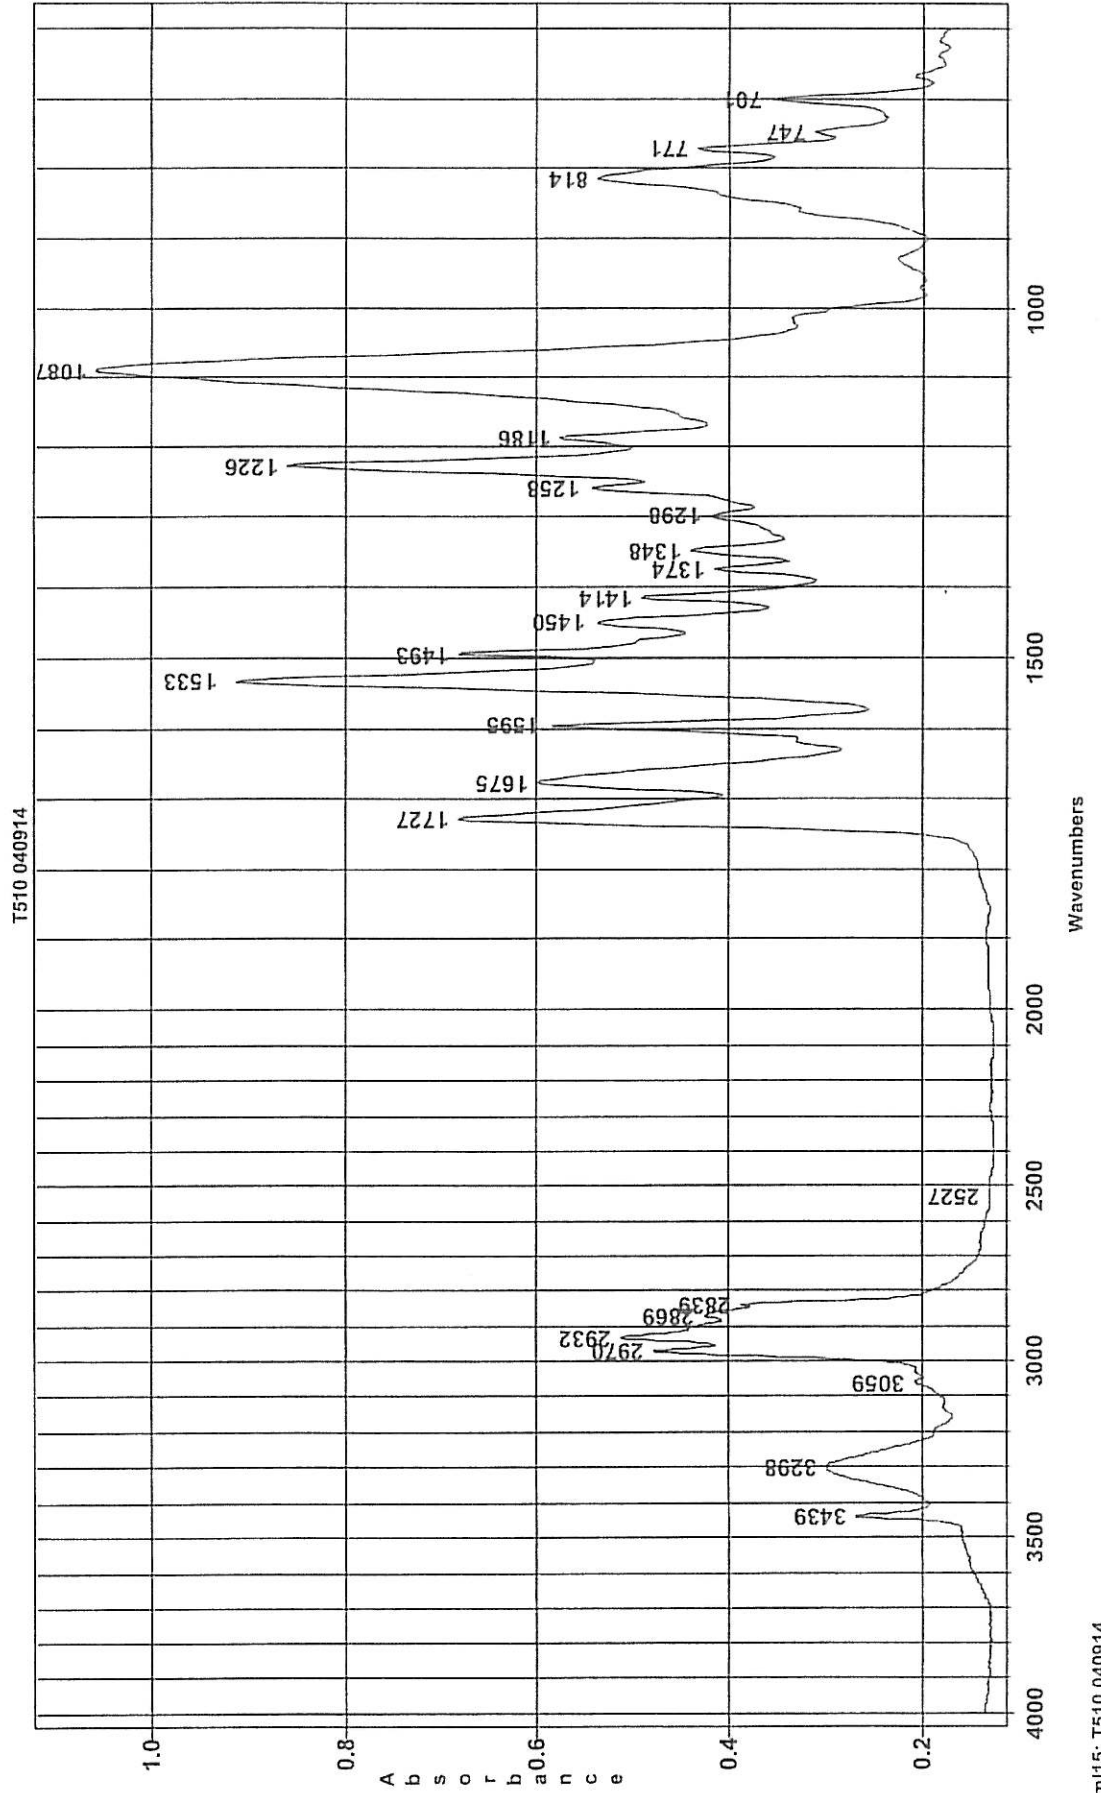

National
Phone
+46 3
+46 3
info@